



SMOKE GUARD® *system*

Model 2500

Vertical Fire + Smoke Curtains

System Description. The Smoke Guard System **Model 2500** is a fire and smoke-rated code compliant assembly designed to protect openings as part of a smoke control system. The **M2500** consists of a fire- or smoke-rated textile curtain assembly mounted within a steel housing. The curtain is captured vertically on both sides by curtain loops secured by guide rods. The guide rods are anchored by side guides to the walls of an opening. A bottom bar seals the curtain at the opening threshold, an optional safety edge may be added to this assembly. Standard housing and side guide finish is galvanized, RAL colors available.

Clear Opening Sizes

- 60' wide, 25' high

Housing Sizes


- 10.5" high by 9" deep ($\leq 12'$ clear opening height)
- 11.75" high by 10.5" deep (12' - 25' clear opening height)

Standards

- NFPA 105 "Installation of Smoke Control Door Assemblies"
- NFPA 80 "Standards for Fire Doors and Other Opening Protectives"
- NFPA 252 "Standard Methods of Fire Tests of Door Assemblies" (20 minute) listed by Intertek
- UL 10B "Fire Tests of Door Assemblies" (20 minute without hose stream) listed by Intertek
- UL 10C "Positive Pressure Fire Tests of Door Assemblies" (20 minute without hose stream) listed by Intertek
- UL 10D "Fire Tests for Fire Protective Curtains" (2 hours) listed by Intertek
- UL 864 "Control Units for Fire Protective Signaling Systems" listed by Intertek
- UL 1784 "Air Leakage Tests of Door Assemblies" listed by Intertek

Code References

- 2009/2012/2015/2018/2021 IBC Section 909
- 2009/2012/2015 IBC Section 716.5.3
- 2018/2021 IBC Section 716.2.2.1

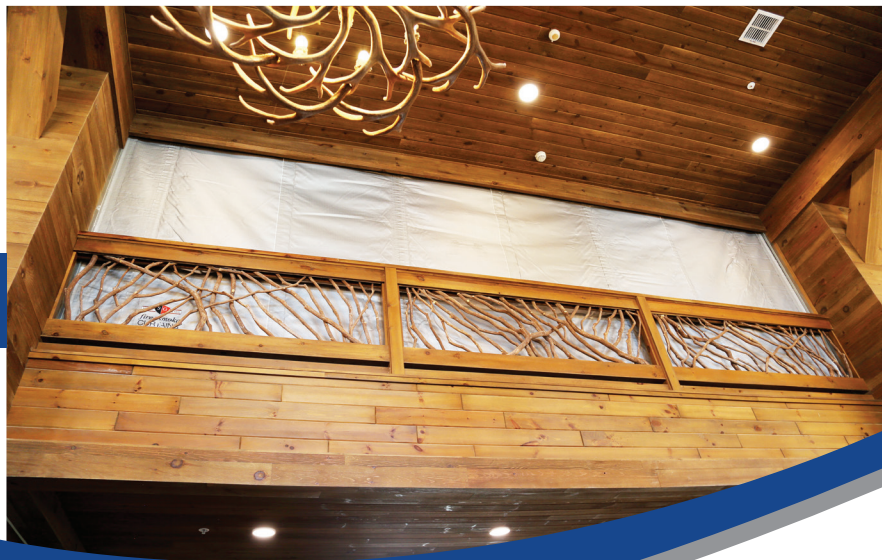


Codes and Standards. **M2500** fulfills IBC requirements to provide an opening protective, where these assemblies are permitted as passive barriers used in conjunction with smoke control systems. This fire or smoke-rated curtain system can serve as an opening protective for counter top, openings in corridors, and applications in atriums.



Designed, Assembled, and Tested in the USA



Model 2500 Vertical Fire + Smoke Curtains

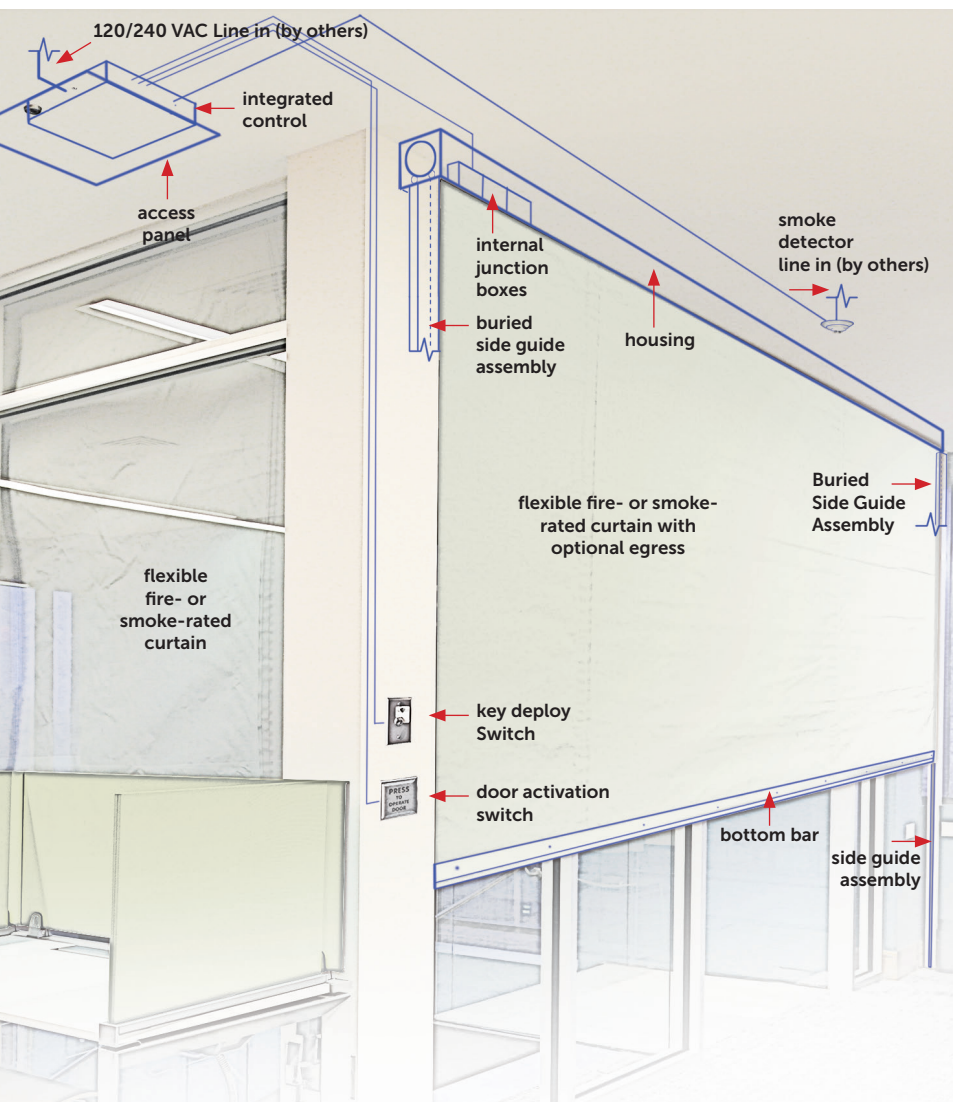

System Operation. The system is deployed upon a signal from the local smoke detection system or from a smoke control panel, normally open dry contact initiates deployment. System power requirement is 120/240 VAC. The unit is also equipped with a 24 VDC battery back-up system that is maintained by the electronic controls. When required, the system can be connected to building standby power. The controls include a universal power supply that can be adapted to foreign electrical current requirements.

Installation. The system is typically mounted above the ceiling. It anchors to the ceiling above or on to a header assembly supported from the deck above. It may also be mounted to a wall. The side guides are secured to the walls on either side of the opening and may be embedded for smooth finish walls. All Smoke Guard system units are to be installed by factory recognized installation personnel. Preparation work required by others is outlined in the product specification. Installation requires clear, plumb, unobstructed wall surfaces for mounting side guides, housing, and AC power.

Designed, 
Assembled and
Tested in the USA ★

Fail Safe Features. This system is a gravity fail safe system. The **M2500** features a fault report to indicate that the system requires a corrective action and the state of curtain deployment.

Listed Releasing Device. The **M2500** control has been tested in accordance with the UL 864 standard and listed by Intertek Laboratories. It also has a full interface to the fire service interface system (FSCS) as an option for dedicated smoke control.

Smoke Guard and Your Project

- ☐ Check for clearance/obstructions issues on, above, and surrounding the opening (sprinklers, HVAC, etc.)
- ☐ Field verify opening measurements prior to ordering systems
- ☐ Single motor units require a 120/240 VAC with a 10 amp circuit per unit
- ☐ Install the system control in visual proximity of the unit for servicing ease
- ☐ Provide a level and plumb smoke or fire-rated mounting surface to attach to per building code requirements